
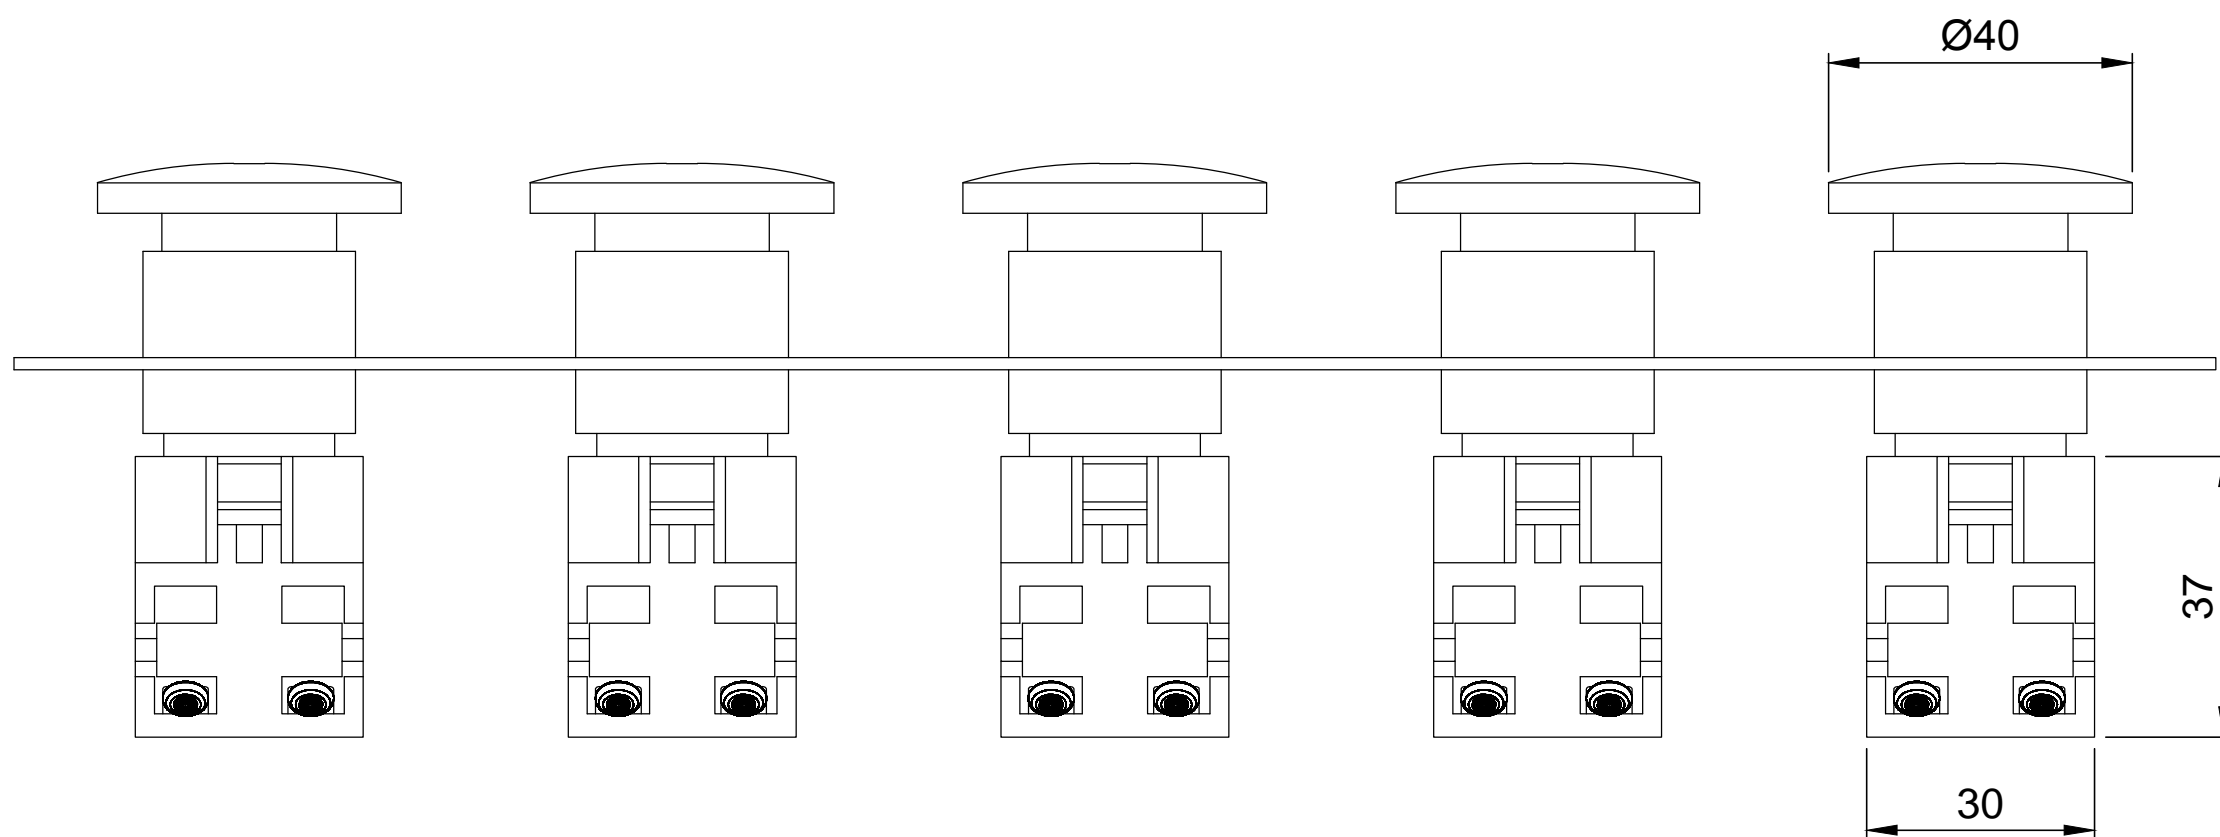
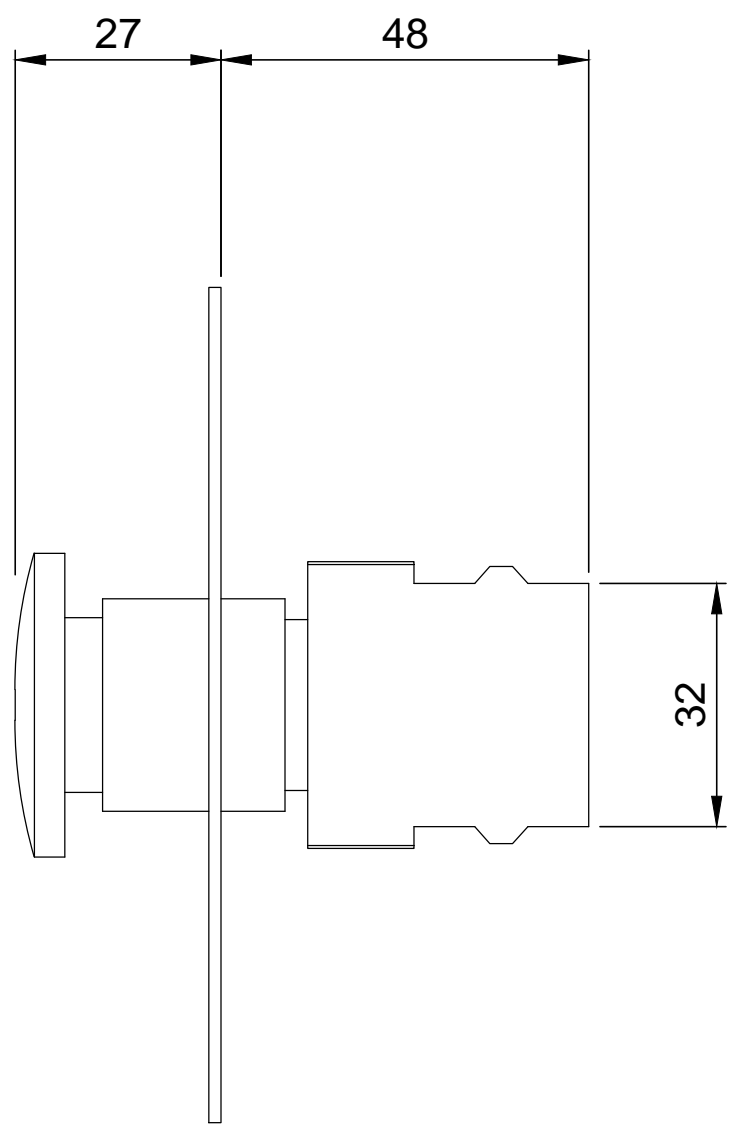


DO NOT SCALE

IF IN DOUBT - ASK!


PBP-005/C1 EVACUATION PANEL INSTALLATION DETAILS

PANEL DIMENSIONS

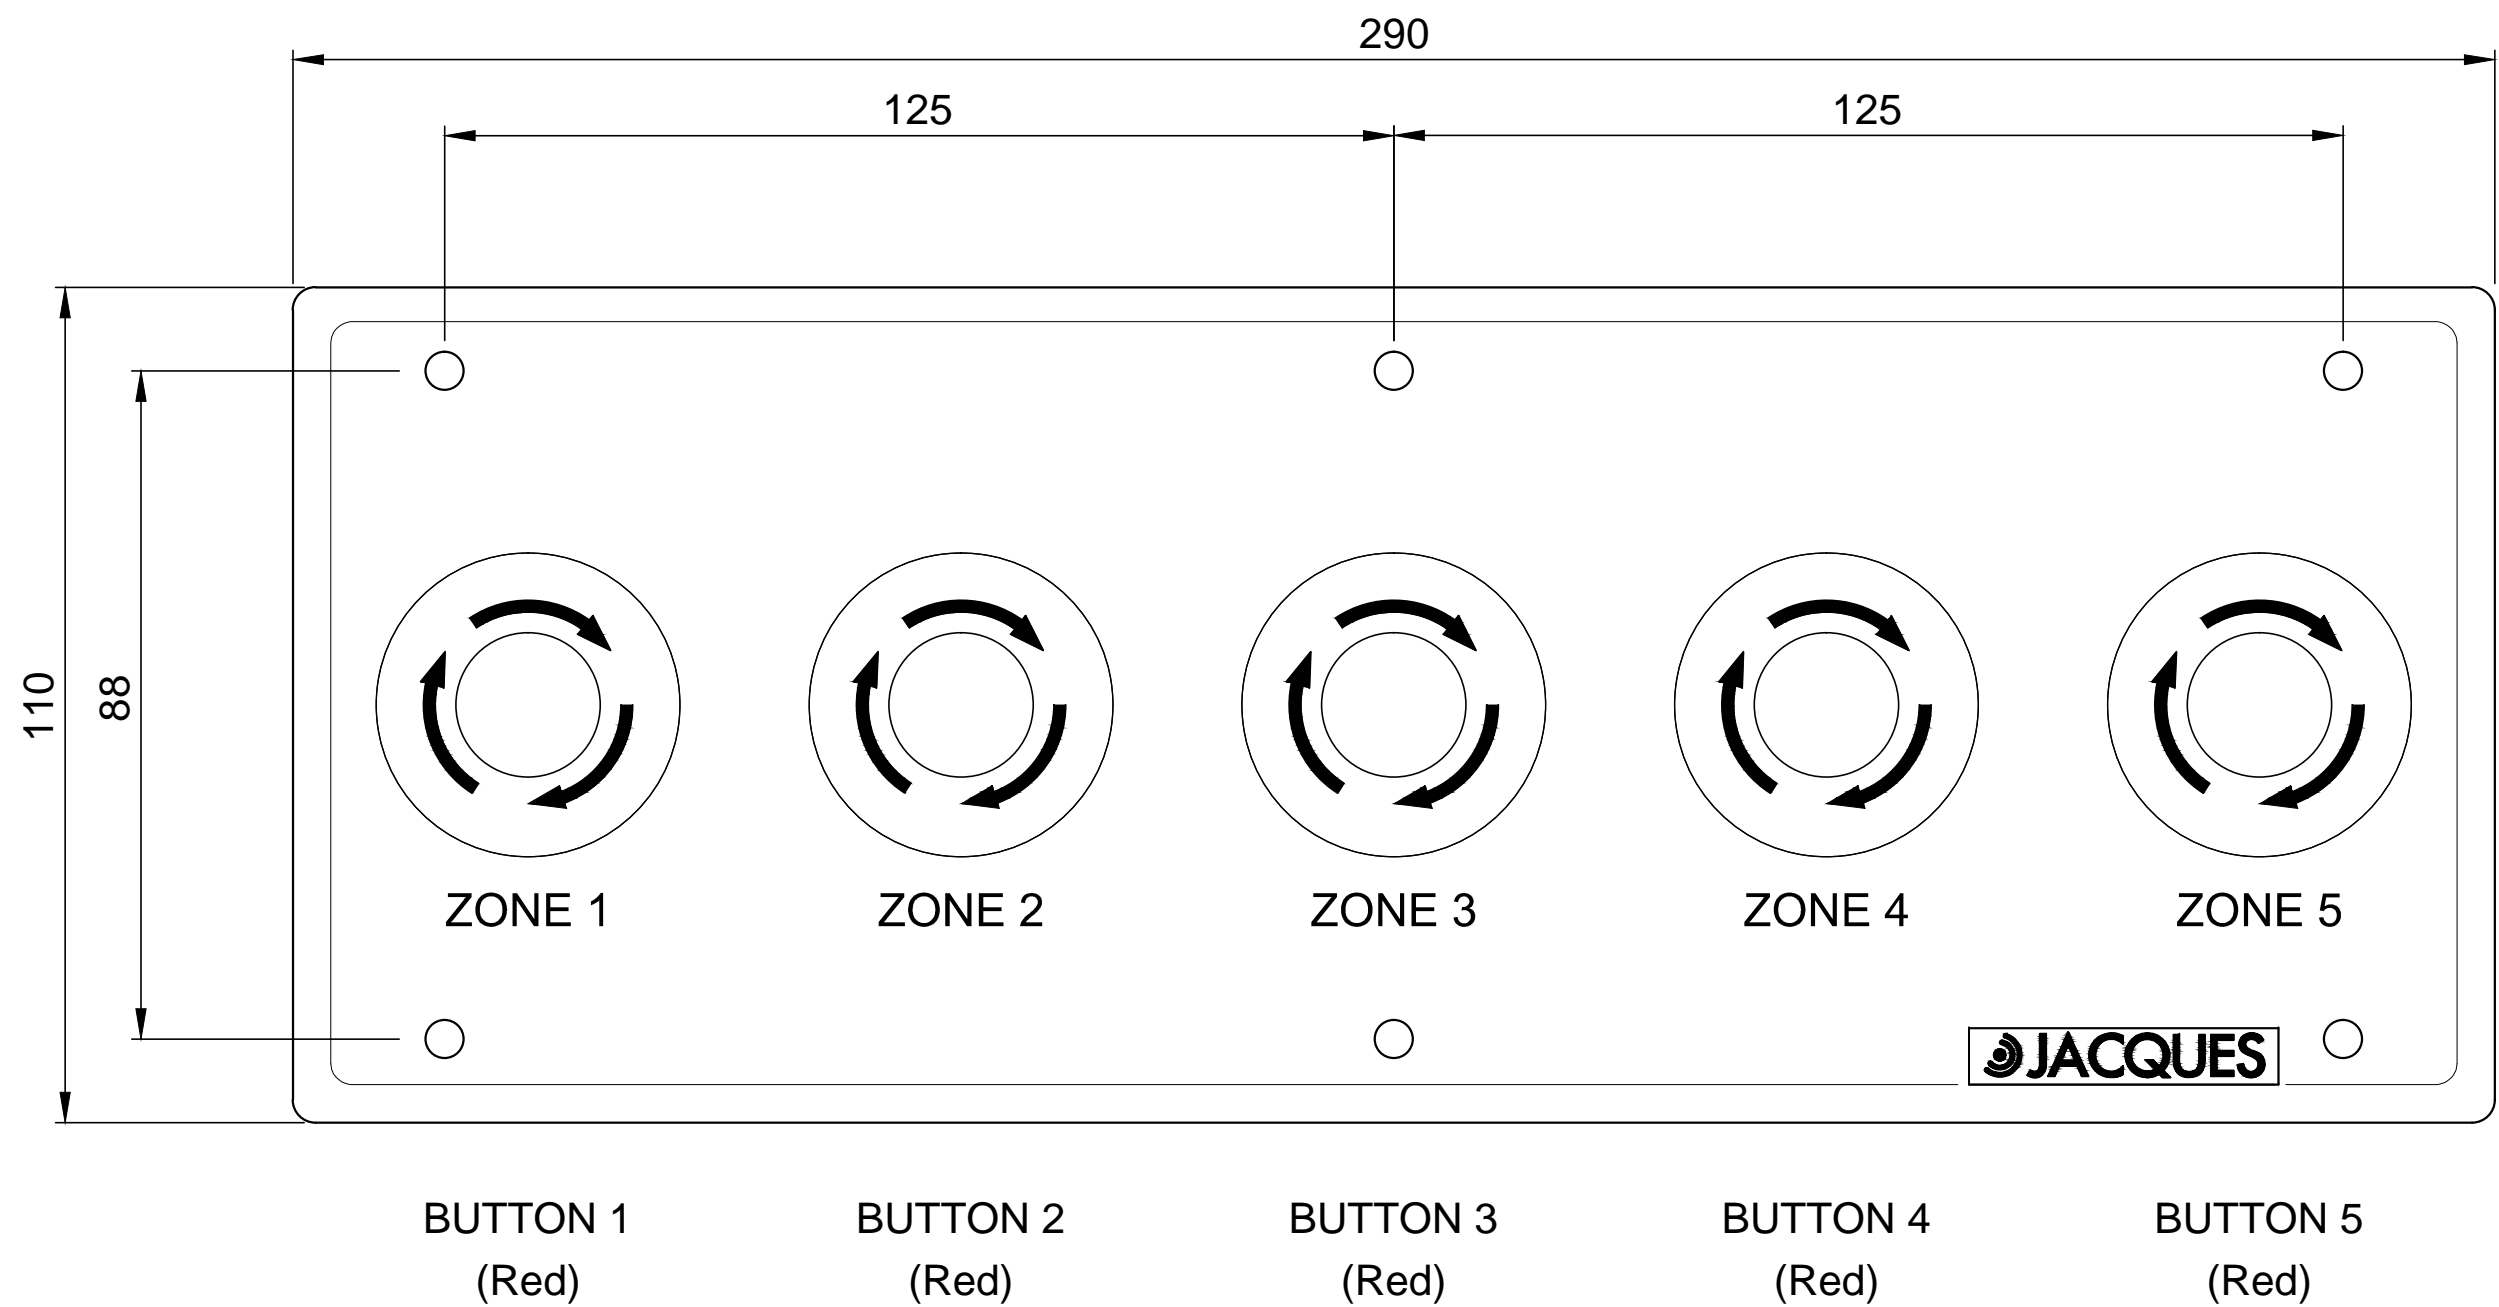

Notes:


- Switches  
ONPOW, Y090 Series, A Type Pushbutton Switches  
Y090-A-11TS/R (red)  
  
Type - Latching mushroom type actuator Pushbuttons.  
Twist to release.  
Switch has 1 x Normally Closed contact and  
1 x Normally Open contact.  
These each have independent clamping type screw terminations.
- The artwork (laser etch, black) example shown is PBP-005/C1. For other applications this may be fully customised.
- The colour of the push button actuators shown is for PBP-005/C1. Any combination of red, green and yellow buttons may be selected as customisation.

REV	DATE	CHANGE DESCRIPTION	BY	<div><div><div><div><div><div></div><div>Future Proof Communications</div></div></div><div><div><div><div><div><div>(C) Copyright Jacques Technologies Pty Ltd. All rights reserved.</div><div>28-30 Bank Street, West End Q 4101</div><div>Ph: +61 7 3846 8400</div><div>www.jacques.com.au</div><div>info@jacques.com.au</div></div></div></div><div><div><div>PBP-005/C1 EVACUATION PANEL</div><div>INSTALLATION DETAILS</div></div><div><div><div>DRAWN: LFB</div><div>DATE: 2019-08-29</div></div><div><div>ADAPTED FROM: 51896-INS</div><div>FILENAME: 52083-INS.dwg</div></div><div><div>CHECKED: PJB</div><div>DATE: 2019-09-05</div></div><div><div>SCALE: N.T.S.</div><div>SHEET: 1 of 3</div><div>SIZE: A1</div></div><div><div>APPROVED: PJB</div><div>DATE: 2019-09-05</div></div><div><div>DWG NO: 52083-INS</div><div>REV: 0</div></div></div></div></div></div></div></div></div>
0	2019-09-05	FIRST RELEASE	LFB	


DO NOT SCALE

IF IN DOUBT - ASK!

PBP-005/C1 EVACUATION PANEL INSTALLATION DETAILS  
WIRING INFORMATION

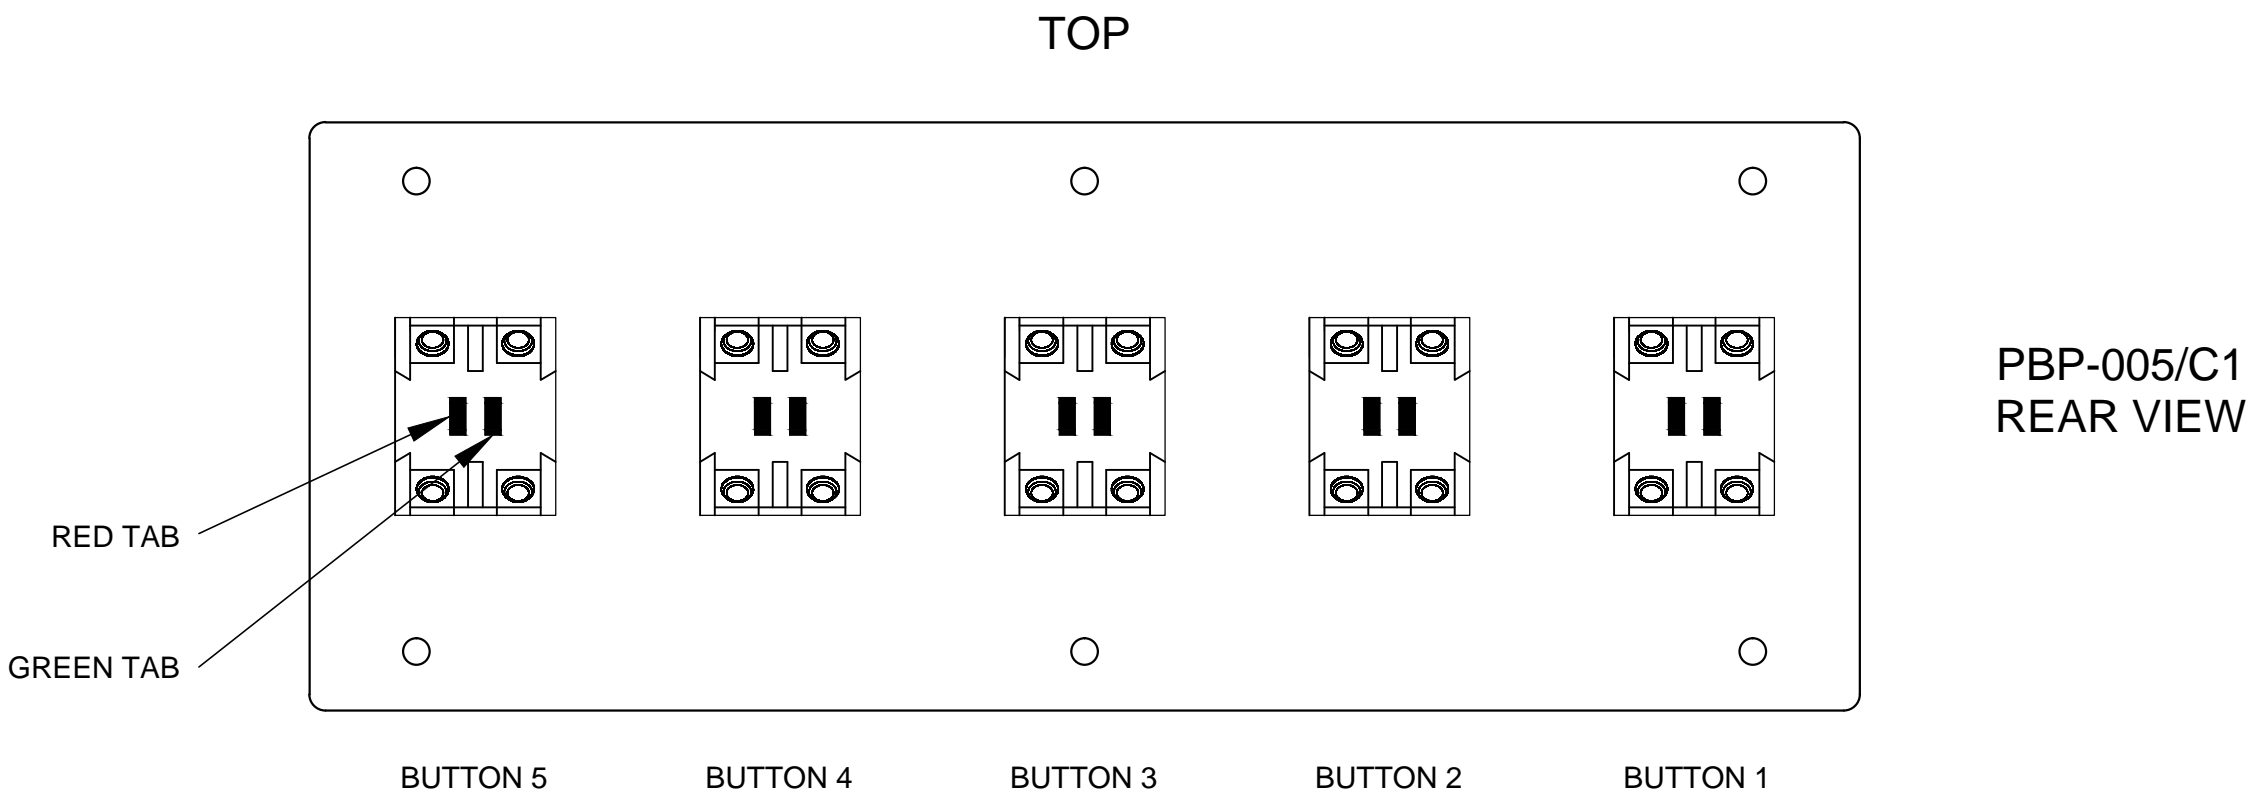

ORIENTATION OF  
SWITCH TERMINALS

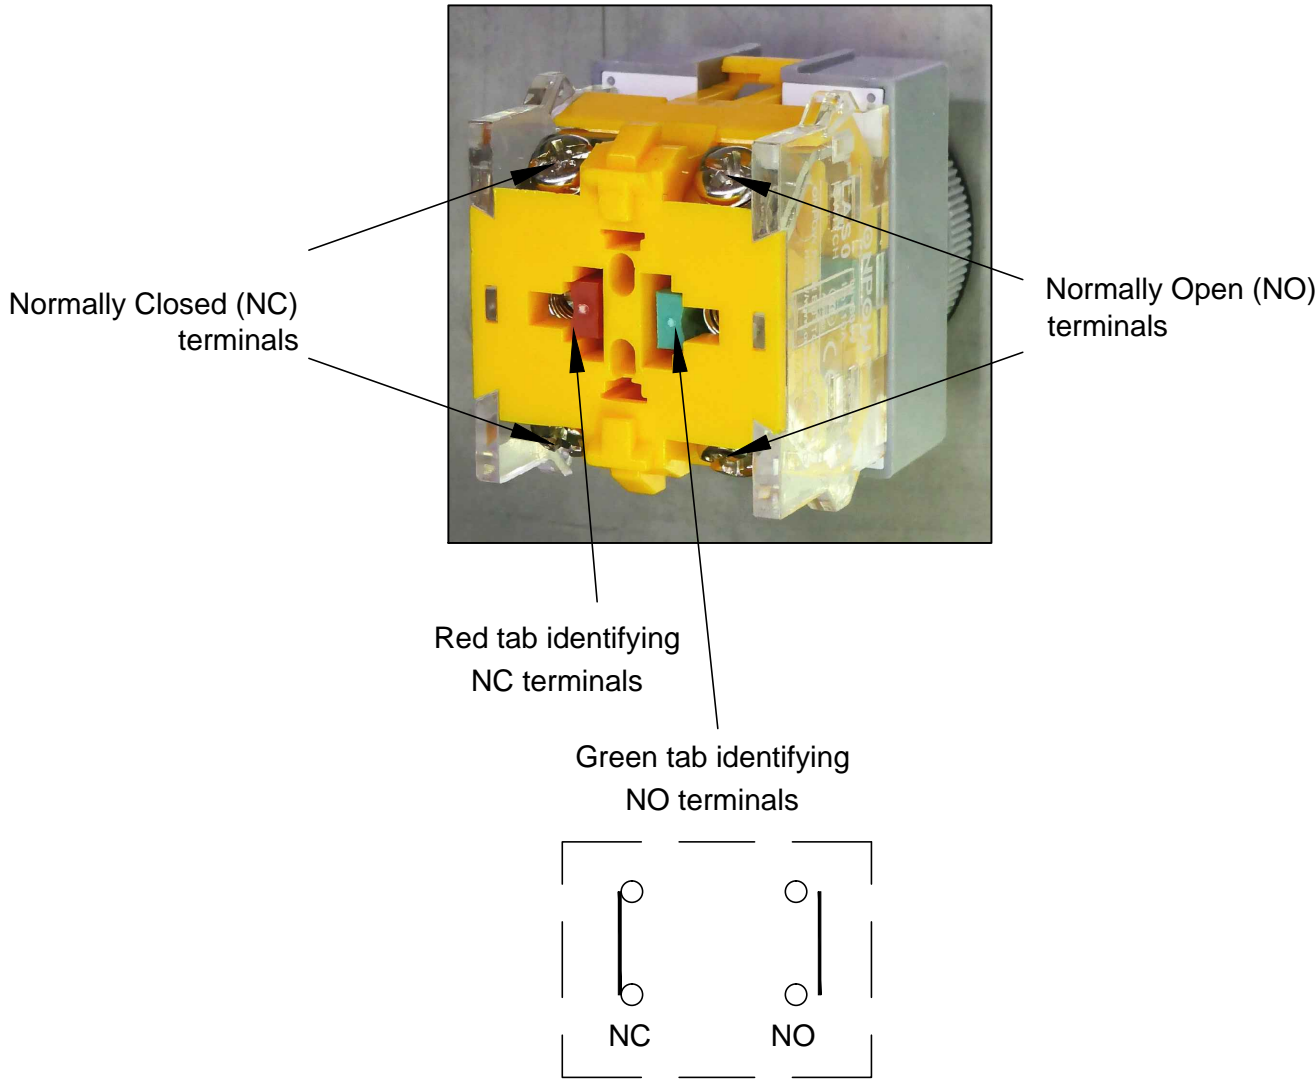


NOTES:

1. The switches shall be wired according to the system functional requirements.
2. Either NO or NC terminals can be used depending on function.
3. Refer to Australian Standards for the appropriate type installation.
4. Accepts 2 x 1.5 mm dia. wires maximum

Maximum Contact Rating


Rated Voltage	24 V	48 V	110 V	220 V	380 V	500 V
Direct Current	10 A	5 A	2.2 A	1.1 A		
Alternating Current P.F. = 0.7			10 A	6 A	4 A	2 A

REV	DATE	CHANGE DESCRIPTION	BY	 <div>(C) Copyright Jacques Technologies Pty Ltd. All rights reserved. 28-30 Bank Street, West End Q 4101 Ph: +61 7 3846 8400 www.jacques.com.au info@jacques.com.au</div>																												
0	2019-09-05	FIRST RELEASE	LFB																													
				<div>PBP-005/C1 EVACUATION PANEL INSTALLATION DETAILS</div> <table><tr><td>DRAWN:</td><td>DATE:</td><td>ADAPTED FROM:</td><td>FILENAME:</td></tr><tr><td>LFB</td><td>2019-08-29</td><td>51896-INS</td><td>52083-INS.dwg</td></tr><tr><td>CHECKED:</td><td>DATE:</td><td>SCALE:</td><td>SHEET:</td><td>SIZE:</td></tr><tr><td>PJB</td><td>2019-09-05</td><td>N.T.S.</td><td>2 of 3</td><td>A1</td></tr><tr><td>APPROVED:</td><td>DATE:</td><td>DWG NO:</td><td colspan="2">REV:</td></tr><tr><td>PJB</td><td>2019-09-05</td><td>52083-INS</td><td colspan="2">0</td></tr></table>	DRAWN:	DATE:	ADAPTED FROM:	FILENAME:	LFB	2019-08-29	51896-INS	52083-INS.dwg	CHECKED:	DATE:	SCALE:	SHEET:	SIZE:	PJB	2019-09-05	N.T.S.	2 of 3	A1	APPROVED:	DATE:	DWG NO:	REV:		PJB	2019-09-05	52083-INS	0	
DRAWN:	DATE:	ADAPTED FROM:	FILENAME:																													
LFB	2019-08-29	51896-INS	52083-INS.dwg																													
CHECKED:	DATE:	SCALE:	SHEET:	SIZE:																												
PJB	2019-09-05	N.T.S.	2 of 3	A1																												
APPROVED:	DATE:	DWG NO:	REV:																													
PJB	2019-09-05	52083-INS	0																													


DO NOT SCALE

IF IN DOUBT - ASK!

PBP-005/C1 EVACUATION PANEL INSTALLATION DETAILS  
EXAMPLE CONNECTION DIAGRAM FOR USING EVACUATION PANEL IN JACQUES 650 SYSTEM

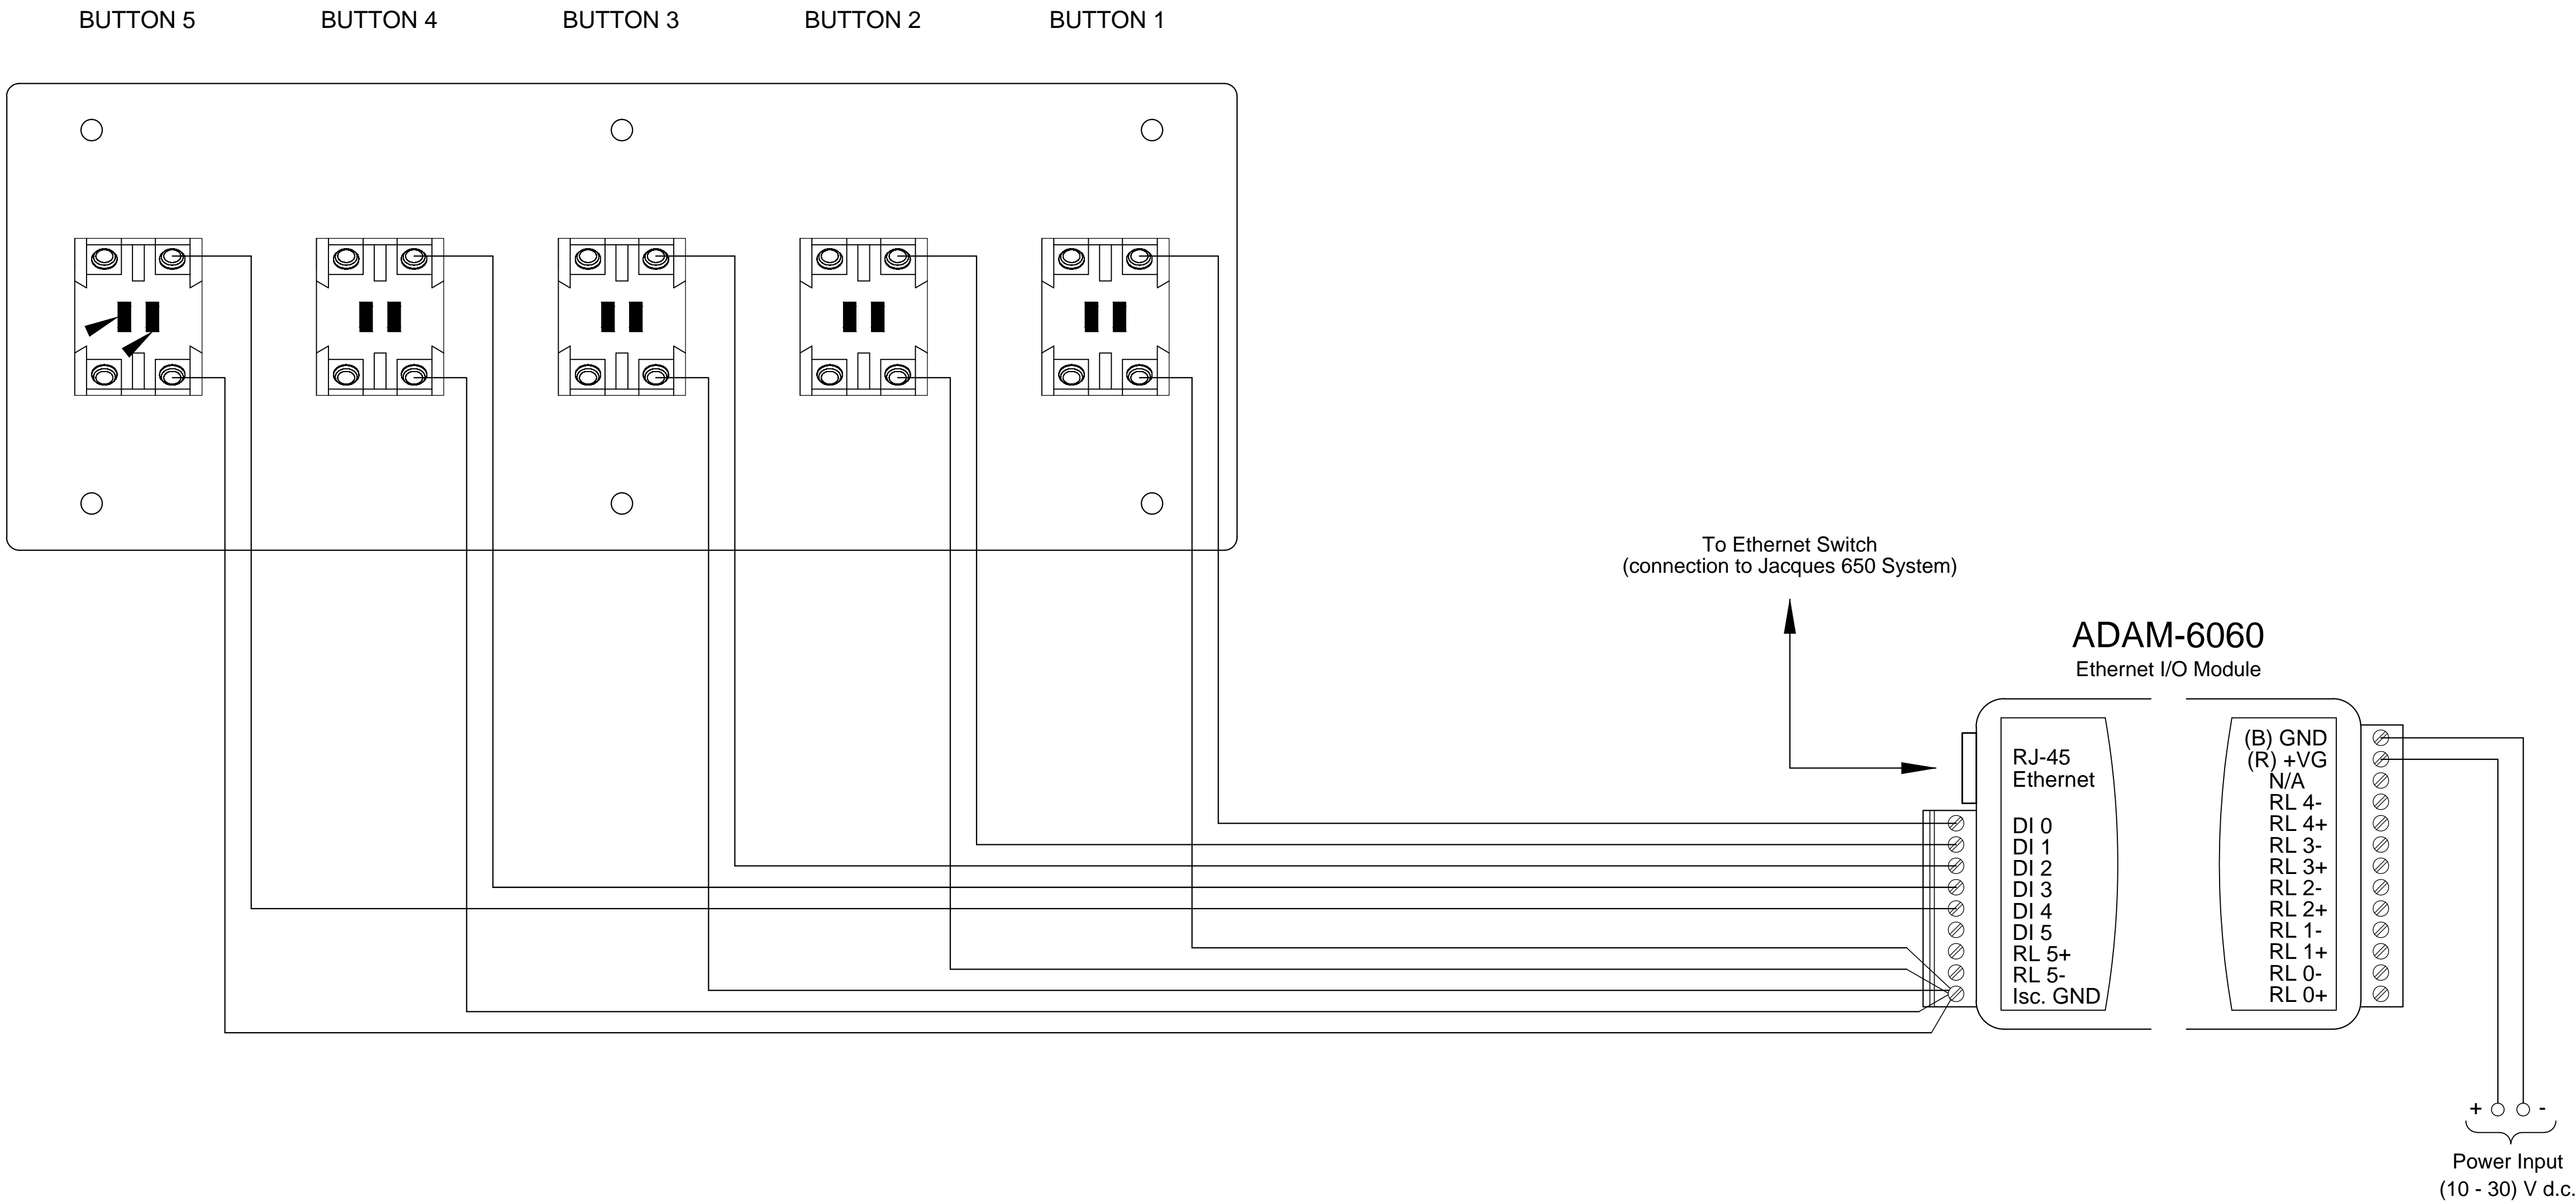

REV	DATE	CHANGE DESCRIPTION	BY
0	2019-09-05	FIRST RELEASE	LFB

		(C) Copyright Jacques Technologies Pty Ltd. All rights reserved. 28-30 Bank Street, West End Q 4101 Ph: +61 7 3846 8400 www.jacques.com.au info@jacques.com.au	
<b>PBP-005/C1 EVACUATION PANEL INSTALLATION DETAILS</b>			
DRAWN: LFB	DATE: 2019-08-29	ADAPTED FROM: 51896-INS	FILENAME: 52083-INS.dwg
CHECKED: PJB	DATE: 2019-09-05	SCALE: N.T.S.	SHEET: 3 of 3
APPROVED: PJB	DATE: 2019-09-05	DWG NO: 52083-INS	SIZE: A1 REV: 0