

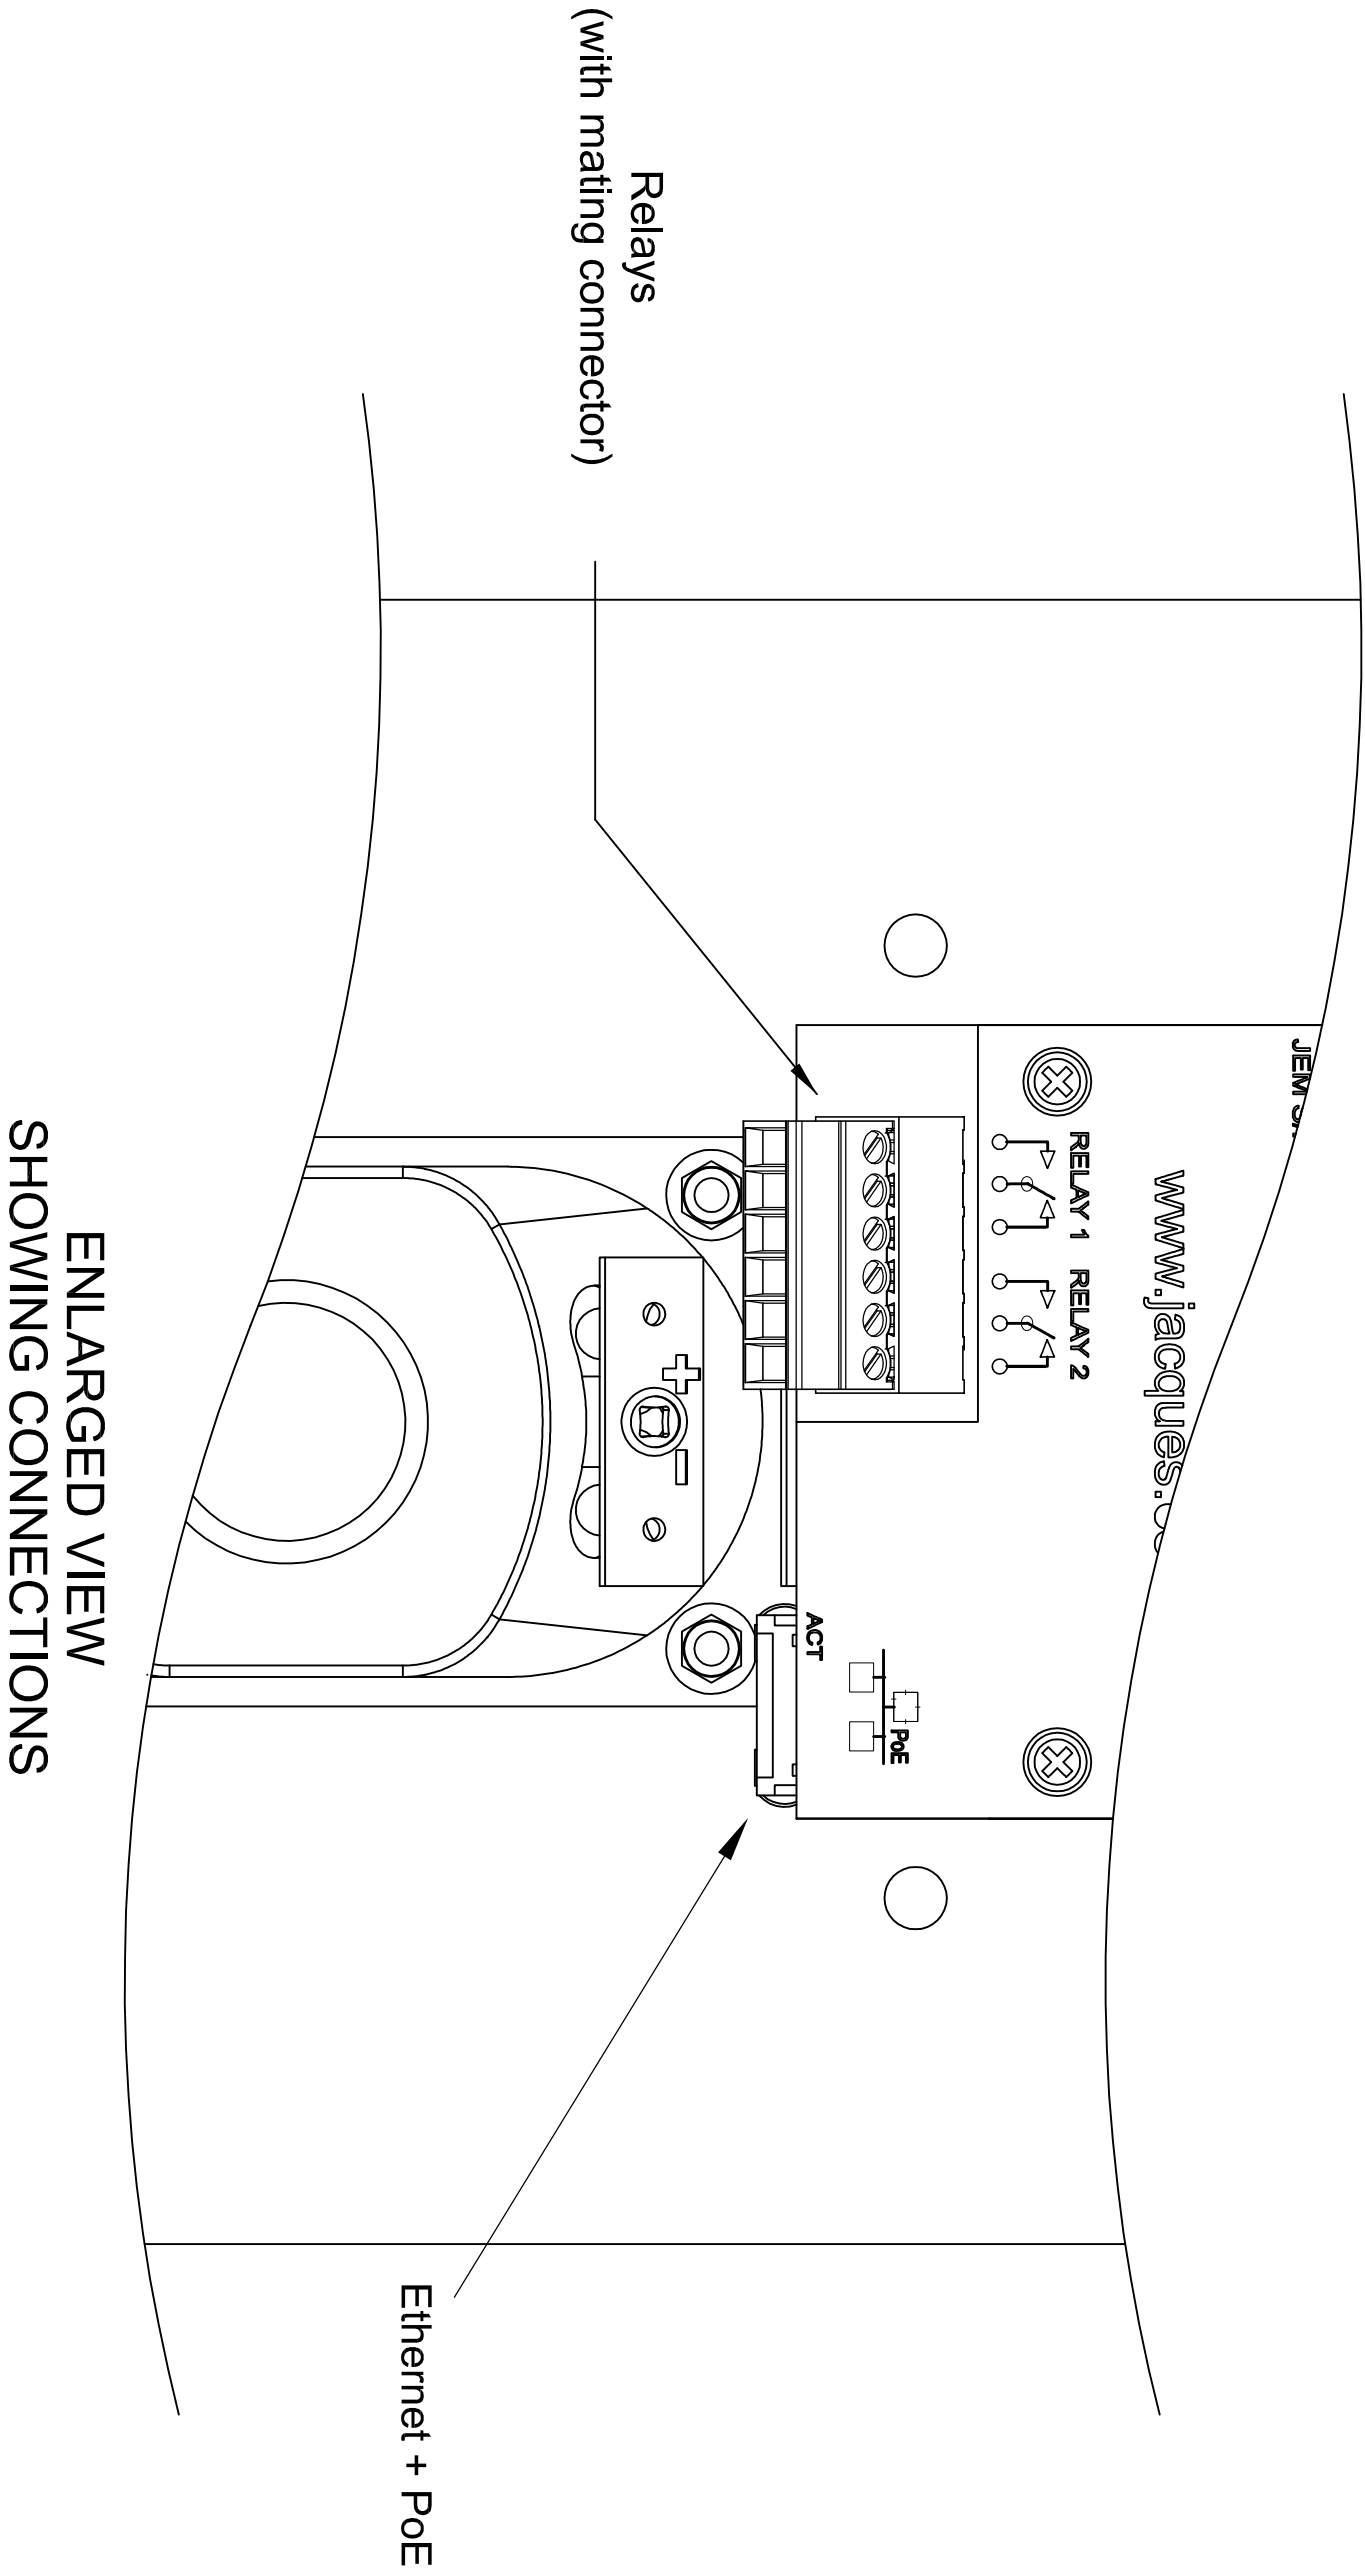
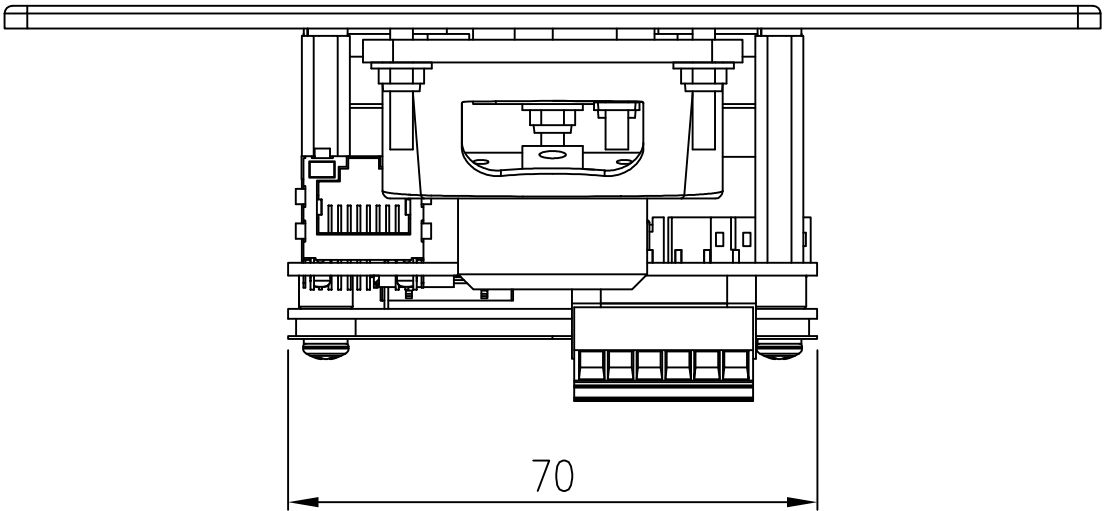
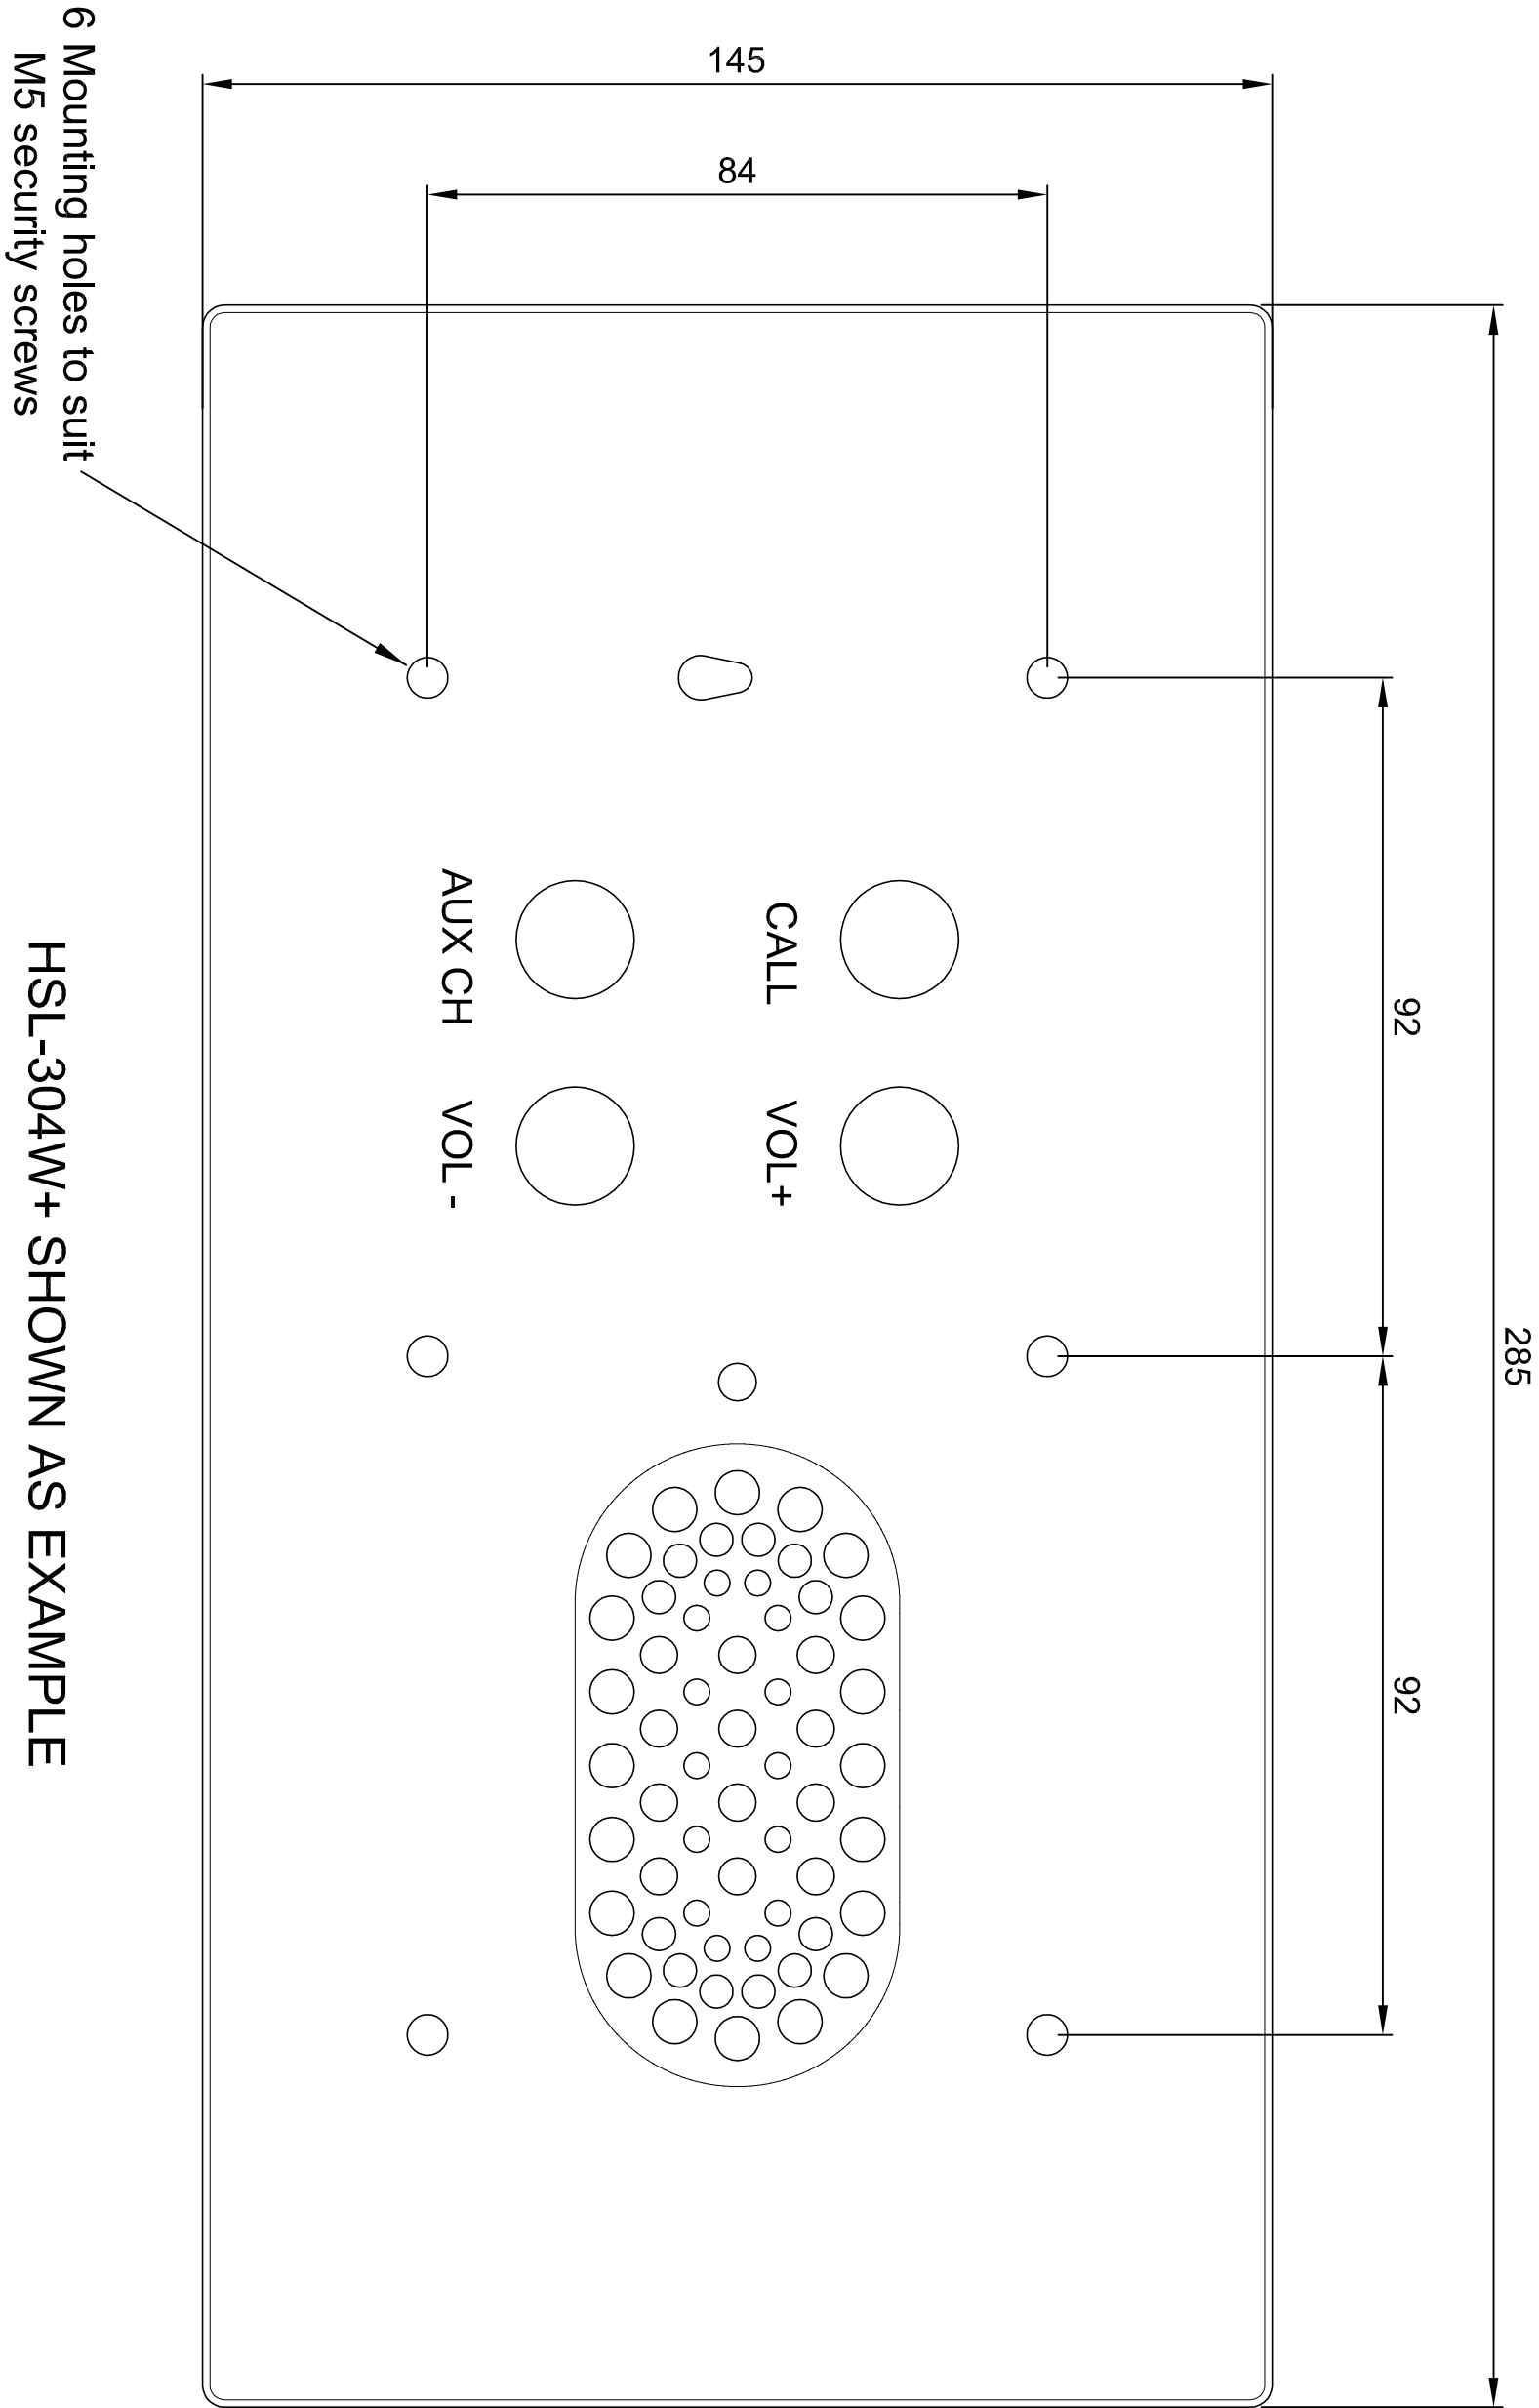



HSL-30xw+ INTERCOM STATION INSTALLATION DETAILS

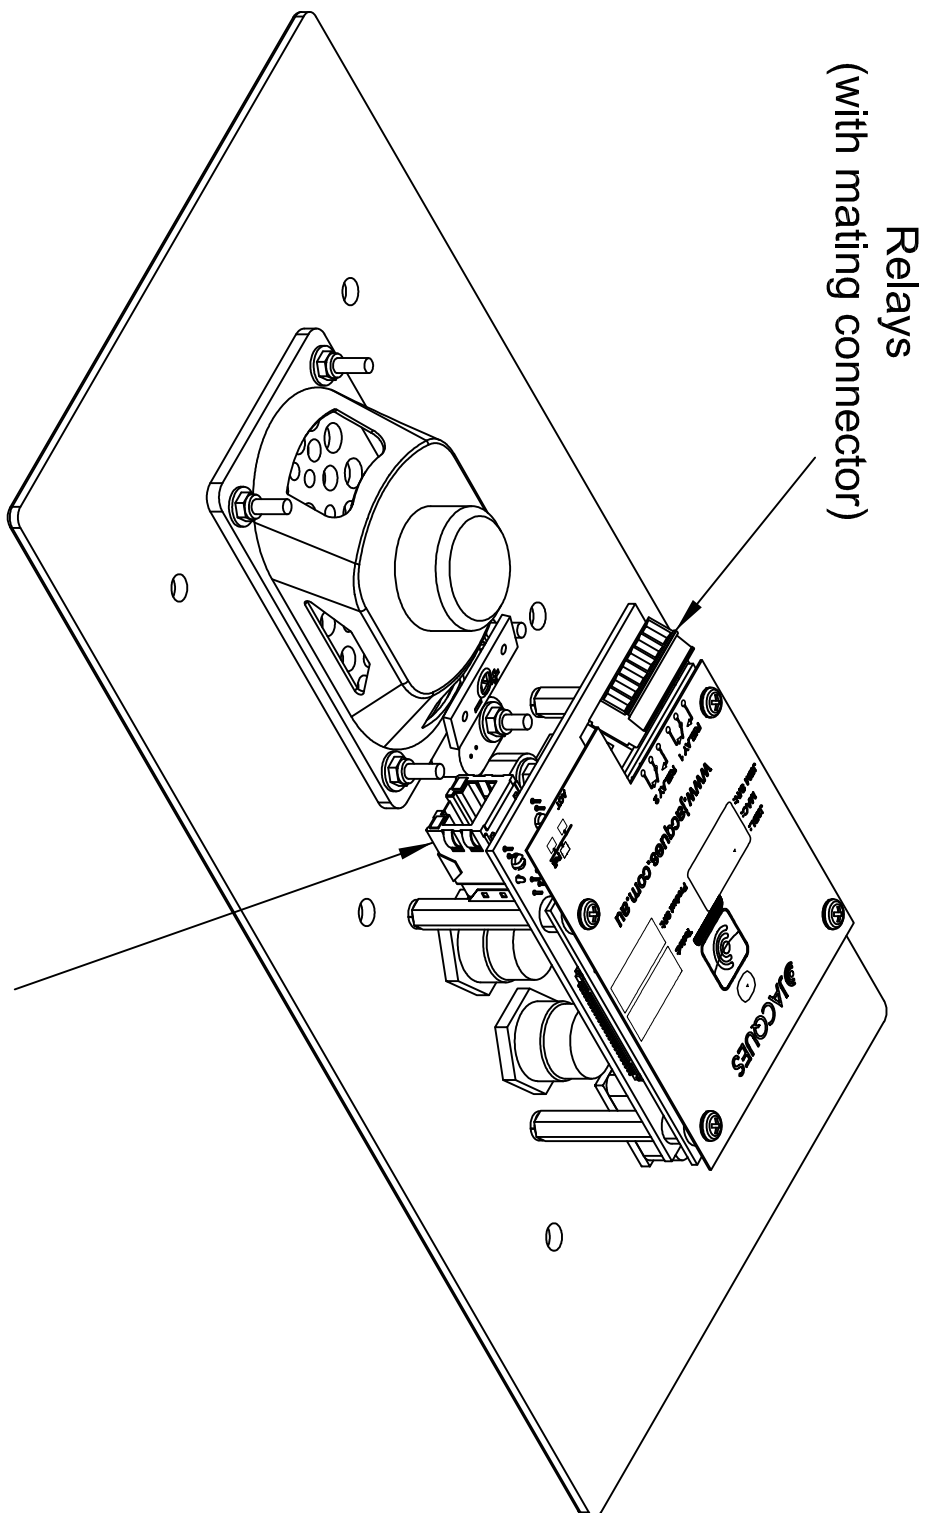

- Notes:
1. Power Input: via IEEE 802.3af PoE (Class 2)
 2. Relay contacts rating: 30 V d.c. / 2 A
 3. Gasket/sealing shall be applied by the installer to ensure appropriate water resistance.

REV	DATE	CHANGE DESCRIPTION	BY
0	2016-06-15	FIRST RELEASE	LFB
1	2016-06-22	NOTE 3 REGARDING GASKET/SEALING ADDED.	LFB

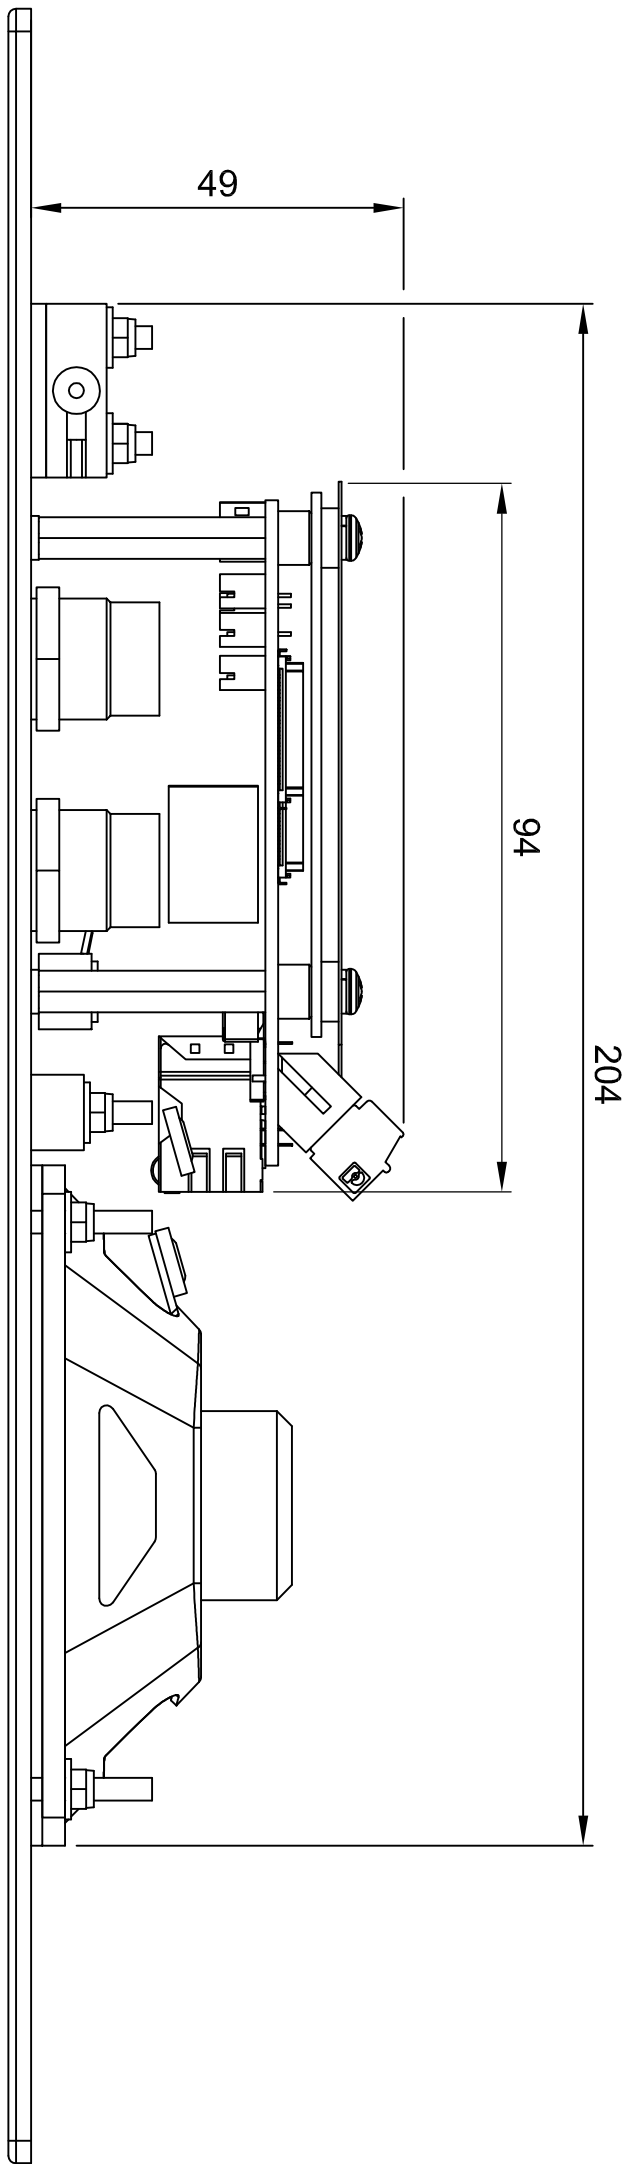

Future Proof Communications

(C) Copyright Jacques Technologies Pty Ltd. All rights reserved.
P.O. Box 431, 73866 Bako, South Australia 5015
Ph: +61 7 3846 8400 Fax: +61 7 3844 1078
www.jacques.com.au info@jacques.com.au

DRAWN: LFB

CHECKED: NTS

APPROVED: HSL-30xw+-INS

DATE: 2016-06-15

DATE: NTS

DATE: HSL-30xw+-INS

ADAPTED FROM: N/A

SCALE: NTS

DWG NO: HSL-30xw+-INS

FILENAME: HSL-30xw+-INS.dwg

SHEET: 1 of 1

REV: 1